


Hangar 6 BSD Pump Station Effluent PFAS Levels 7/2023 - 7/2024

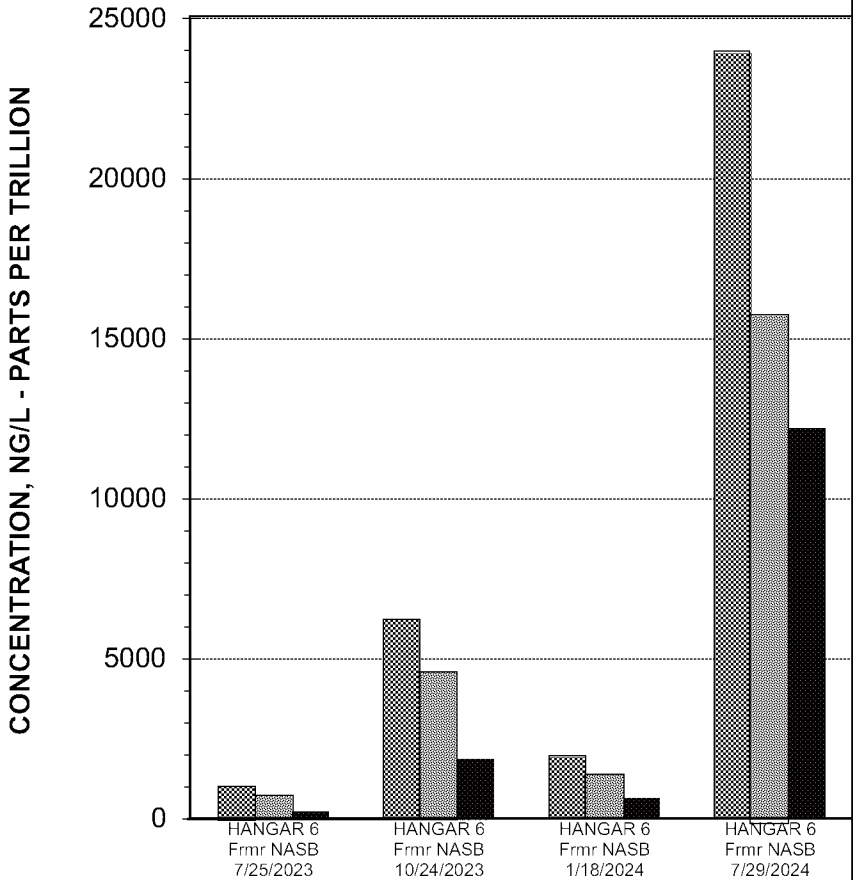

✱ Total PFAS Detected	1024	6213	1934	23928
▨ Total PFOS+PFOA+62FTS	717	4600	1411	15717
■ Total PFOS	246	1871	667	12222